


1. GENERAL NOTES:
REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. SOFFIT PANELS IN GABLE END OVERHANGS CANNOT BE VENTED.
3. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

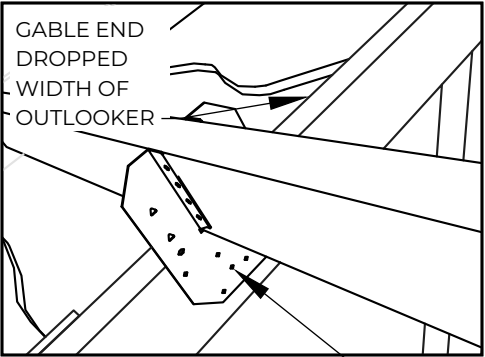

NAILS INTO GABLE END TOP CHORD OR INTO BOTH PLIES OF TOP PLATE IF FRAMED GABLE END WALL.

ROOF SHEATHING MIN. 7/16" THICK NAILED PER FORTIFIED REQUIREMENTS.

ROOF FRAMING MEMBERS @ MAX 24" O.C., TYP.

