GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. APPLICABLE FOR ROOF PITCH 2:12 OR GREATER.
3. LOCAL BUILDING CODE REQUIREMENTS FOR ROOF SHEATHING THICKNESS AND/OR NAIL SIZE/ATTACHMENT SPACING MAY BE MORE STRINGENT BASED ON SITE CONDITIONS.
4. FOR CONCRETE AND CLAY TILE ROOF COVERS, MINIMUM REQUIRED SHEATHING THICKNESS IS 15/32".
5. FULL ROUND HEAD DIAMETER; NO CLIPPED-HEAD NAILS, COMMON NAILS OR STAPLES SHALL BE ALLOWED. REFER TO FIGURE 1.
6. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.


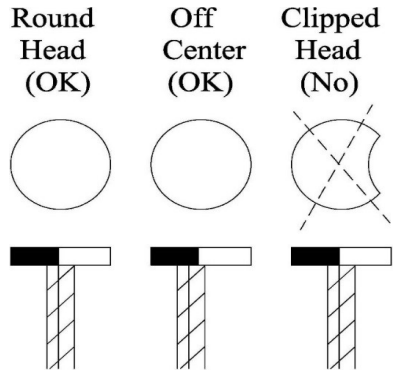



**FIGURE 1.**

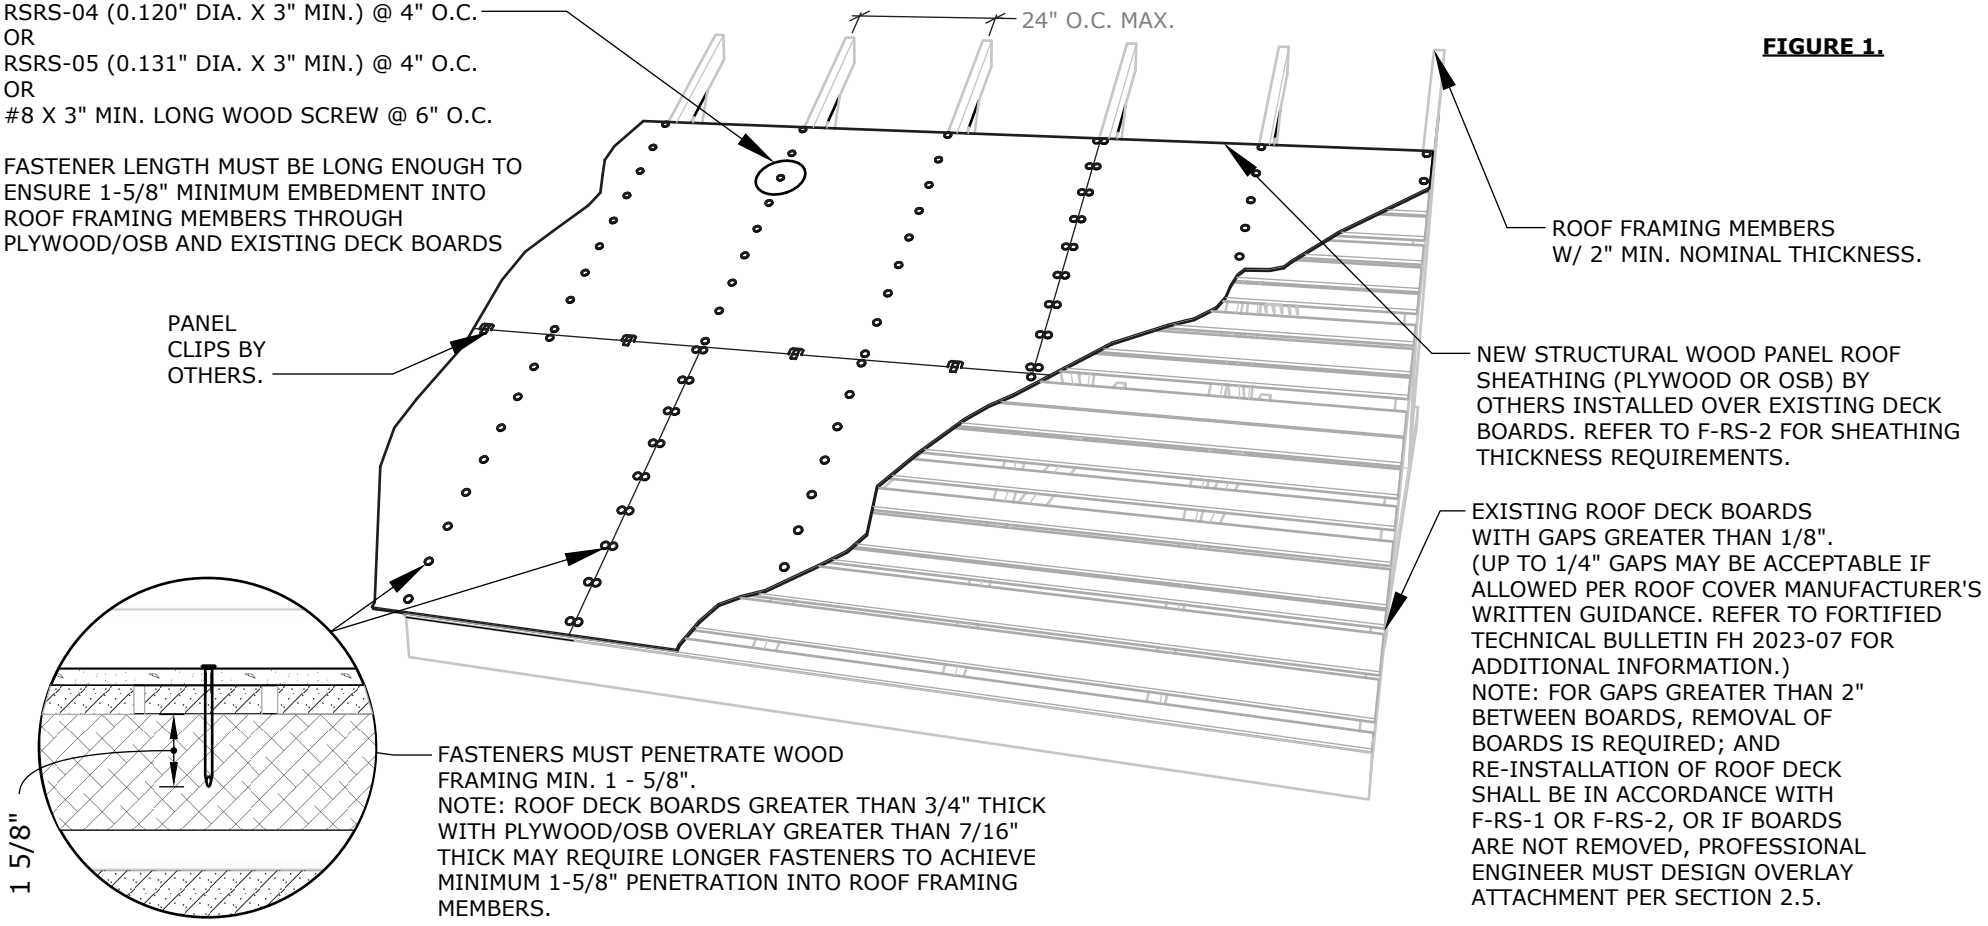


**APPLICABLE STANDARDS:**

FORTIFIED HOME™ - HURRICANE (2025)

FORTIFIED HOME™ - HIGH WIND (2025)

**DESCRIPTION:**

FASTENING WOOD STRUCTURAL PANEL ROOF SHEATHING OVER EXISTING 1X ROOF DECK BOARDS WITH GAPS OVER 1/8"

**DRAWING #:** F-RR-5

**DATE:** 11/01/2026