



GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

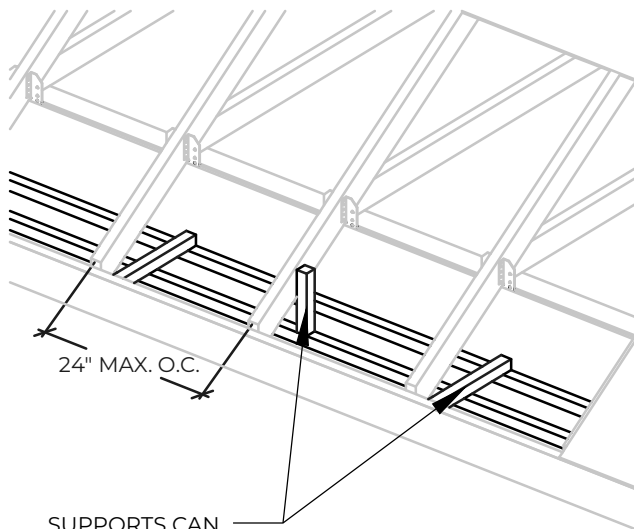

SUPPORTS CAN BE VERTICAL OR HORIZONTAL

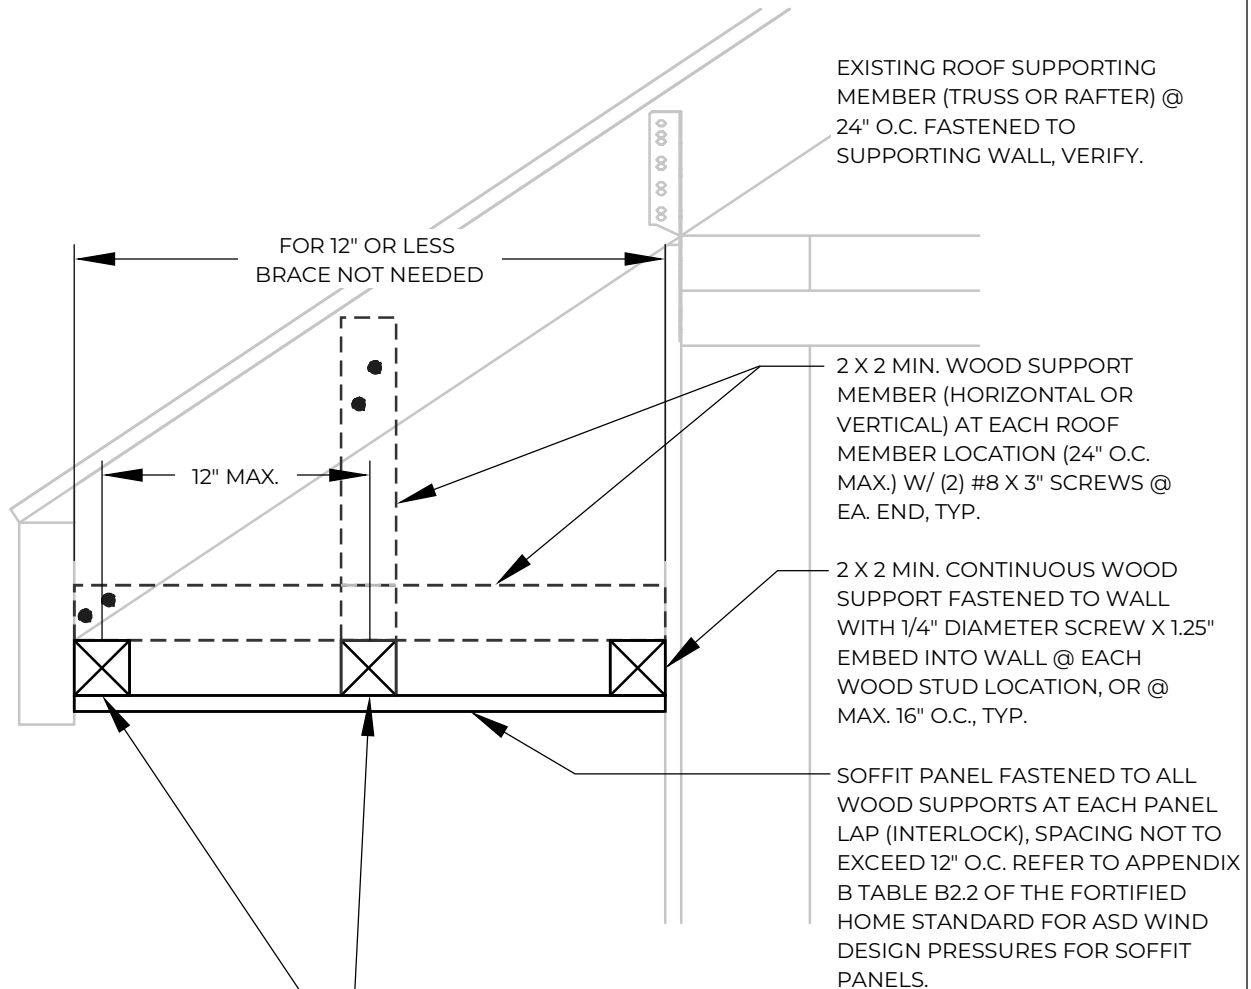

2 X 2 MIN. CONTINUOUS WOOD MEMBER SPACED @ MAX. 12" O.C. FASTENED TO WOOD SUPPORT W/ #8X3" SCREW AT EACH INTERSECTION, TYP.

FASTENERS FOR SOFFIT PANEL MUST BE CORROSION RESISTANT AND MINIMUM ONE OF THE FOLLOWING:
STAPLE 7/16" CROWN X 7/8" LENGTH X 16 GA.
NAIL 6D X 1" EMBEDMENT
SCREW #8 X 1" EMBEDMENT



APPLICABLE STANDARDS:

FORTIFIED HOME™ - HURRICANE (2025)

DESCRIPTION:

SOFFIT RETROFIT DETAIL

DRAWING #:

F-S-1

DATE:

11/01/2024