

GENERAL NOTES:

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. APPLICABLE FOR SHINGLE OR METAL ROOF COVERS.
3. APPLICABLE FOR ROOF PITCH 2:12 OR GREATER.
4. FOR CONCRETE AND CLAY TILE ROOF COVERS, MINIMUM SHEATHING THICKNESS IS 15/32."
5. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

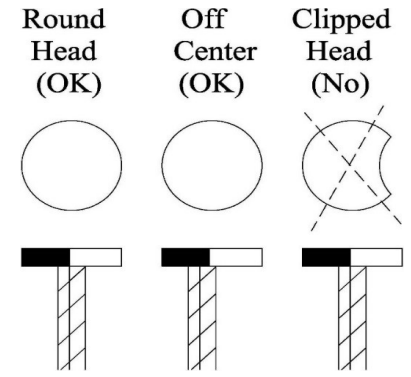


FIGURE 1.

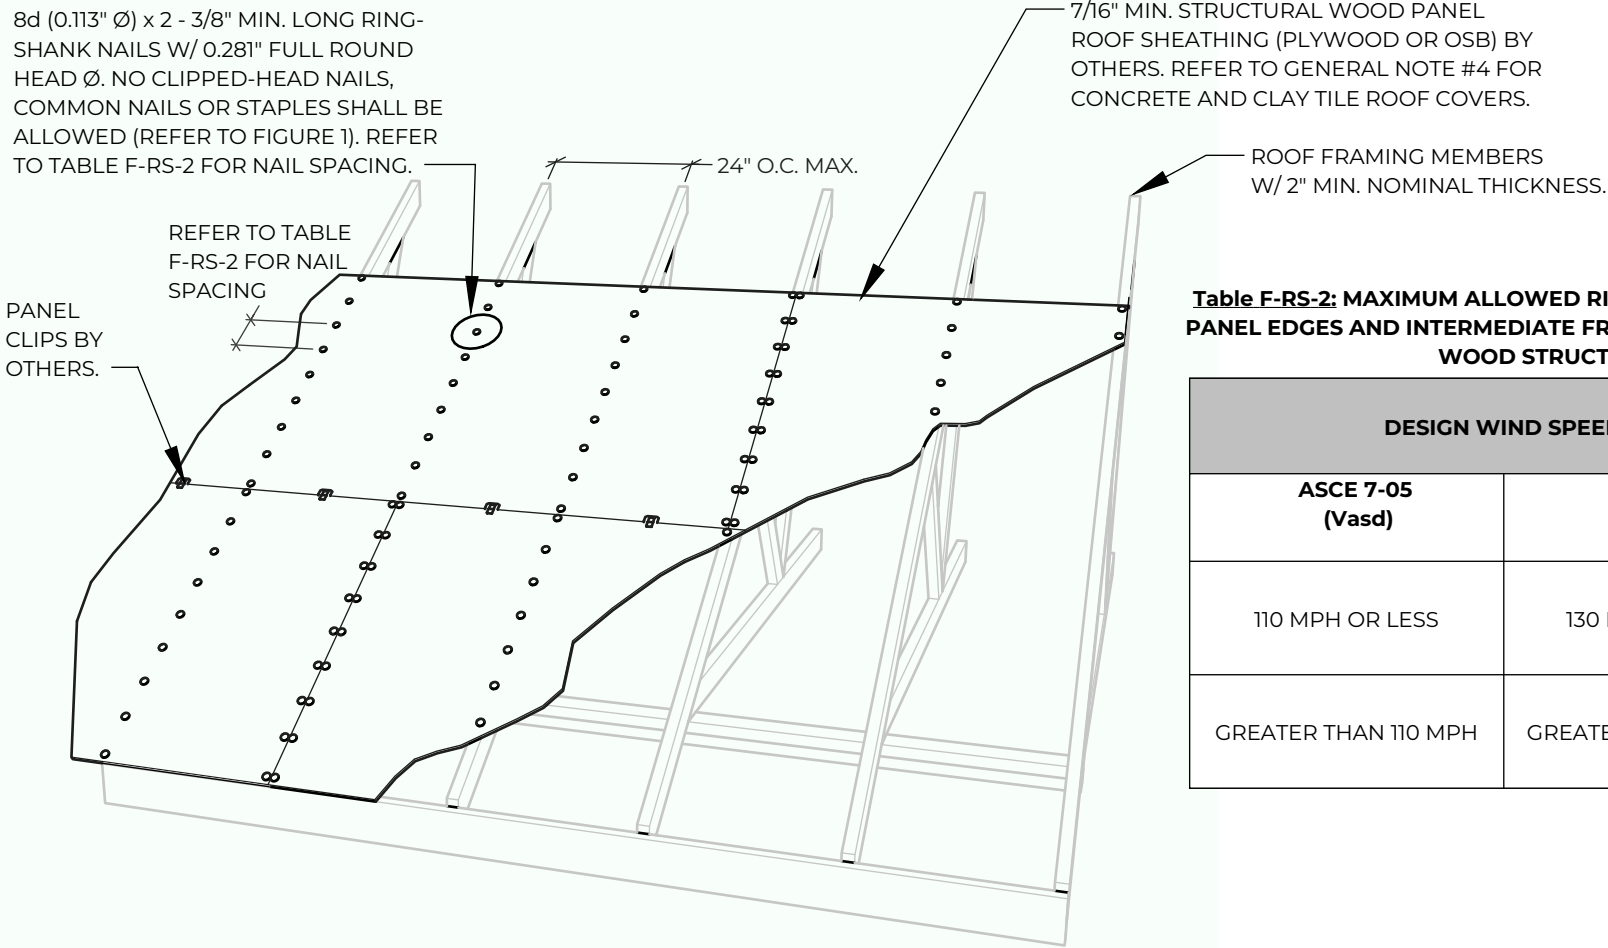


Table F-RS-2: MAXIMUM ALLOWED RING SHANK NAIL SPACING ALONG PANEL EDGES AND INTERMEDIATE FRAMING FOR ATTACHING ROOF DECK WOOD STRUCTURAL PANELS.

DESIGN WIND SPEED		ALL ROOF AREAS
ASCE 7-05 (Vasd)	ASCE 7-10 (Vasd)	
110 MPH OR LESS	130 MPH OR LESS	6" O.C.
GREATER THAN 110 MPH	GREATER THAN 130 MPH	4" O.C.



APPLICABLE STANDARDS:
FORTIFIED HOME™ - HURRICANE (2019)

DESCRIPTION:
HURRICANE - NEW CONSTRUCTION
ROOF DECK ATTACHMENT -
STRUCTURAL WOOD PANELS

DRAWING #:
F-RS-2

DATE: 11/18/2019